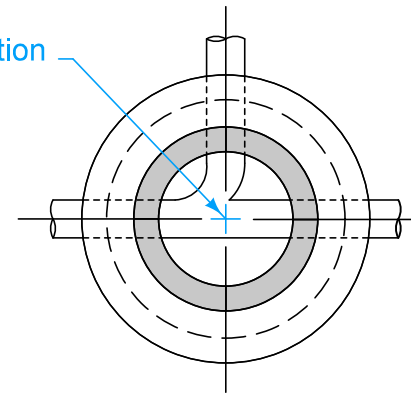


TYPICAL SECTION

Location Station







PLAN

If manhole depth exceeds 20 feet, install steps.

- 1 Cast-in-place base shown. If base is precast integral with bottom riser, the footprint of the base is not required to extend beyond the outer edge of the riser.
- 2 For additional configurations, maintain a minimum of 12 inches of concrete between vertical edges of pipe openings.
- 3 12 inch minimum riser height above all pipe openings.

Manhole Diameter (inches)	Maximum Pipe Diameter (inches) for 2 Pipes <sup>2</sup>	
	At 180° Separation	At 90° Separation
48	24	18
60	36	24
72	42	30
84	48	36
96	60	42

		REVISION	
		4	10-21-25
FIGURE 6010.401	STANDARD ROAD PLAN	<b>SW-401</b>	
		SHEET 1 of 1	
REVISIONS: Updated Sudas and IDOT Logos.			
 SUDAS DIRECTOR		 DESIGN METHODS ENGINEER	
<b>CIRCULAR STORM SEWER MANHOLE</b>			